

OFFICE OF CIVIL SURGEON
KAPURTHALA

No.NVBDCP/Tech/2026:-33.....

Dated:-13/02/2026.....

This is to certify that undersigned along with the team members inspected the site of **Akal Academy Raipur Peer Bakshwala Kapurthala Dist.Kapurthala** Observed that the water Sample of the School is satisfactory.

Water Sample Collected date. 28/01/2026

Under epidemic diseases Act 1897

Amendment 1995.

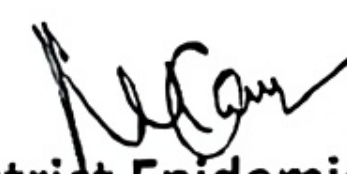
SPH Lab Kharar (Water Quality testing lab Kpt)

Sample No. DwtLkpt/2526/00226 dt. 29/01/2026

Valid up : Date of Testing :

(with Respect to iso 10500: Drinking Water specification-1991)

The source of Water is also With in Satisfactory limit.


District Epidemiologist.
Kapurthala
AKAL ACADEMY
Raipur Peer Bakshwala
Teh. Jhulana (Kpt.)

DISTRICT WATER TESTING LABORATORY, KAPURTHALA

Near Dhaliwal dona, water works, Kapurthala
dwtlkpt@gmail.com

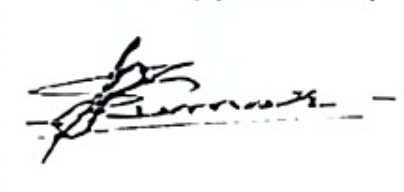


TEST REPORT

Name & Address of Customer : District Epidemiologists KAPURTHALA KAPURTHALA			Customer Reference No.		No : 20 Dated : 28/01/2026	
			Sample Submitted by		MR GURBIR SINGH	
			Date of Sample Receipt		28/01/2026	
			Analysis Starting Date		28/01/2026	
			Analysis completion Date		29/01/2026	
Discipline : Chemical Testing			Group: Water			
ULR No.:	TC144592600000033F		Sample Type :		Water	
Test Report No.:	DWTLKPT/2526/00226		Date of Issue :		29/01/2026	
Registration no.:	DWTLKPT/REG2526/01231		Condition of Sample :		Unsealed	
Collection Point:	Treatment Plant (RO/CWPP/ARP/HH Purifier)		Quantity/Type of Bottle:		1000 ml / Transparent Glass Bottle	
Scheme/Source:	Not Mentioned(Not Mentioned)		Location/Depth :		AKAL ACADEMY RAIPUR PIR BAKSHWALA / NA	
Village :	Not Mentioned		Habitation :		Not Mentioned	
Block:	Nadala		District :		Kapurthala	
Latitude :	Not Mentioned		Longitude:		Not Mentioned	
Sr. No	Parameter	Result	As per IS-10500:2012 (2nd Rev.)		Unit	Reference Method :
			Acceptable Limit	Permissible Limit		
1	pH	7.00	6.5-8.5	No Relaxation	--	IS 3025 (Part 11-2022) Electrometric Method
2	Colour	1	5	15	CU	IS 3025(Part 4-2021) Visual Comparison Method
3	Odour	Agreeable	Agreeable	Agreeable	--	IS 3025 (Part 5 – 2018) (Second Revision)
4	Taste	Agreeable	Agreeable	Agreeable	--	IS 3025 (Part 8 – 2023)
5	TDS	77.00	500	2000	mg/l	IS 3025 (Part 16-2023) Gravimetric Method
6	Turbidity	BDL	1	5	NTU	IS 3025 (Part 10-2023) Nephelometric Method
7	T. Alkalinity(CaCO3)	35.64	200	600	mg/l	IS 3025 (Part 23-2023) Indicator Method
8	T. Hardness(CaCO3)	32.00	200	600	mg/l	IS 3025 (Part 21- 2009)(RA 2023) EDTA Method
9	Calcium(Ca)	8.01	75	200	mg/l	IS 3025 (Part 40-2024) EDTA Titrimetric Method
10	Magnesium(Mg)	2.91	30	100	mg/l	APHA (24th Ed.2023) Method: 3500-Mg+2 B By Calculation Method
11	Chloride(Cl)	4.99	250	1000	mg/l	IS 3025 (Part 32-1988) Argentometric Method

This Report is issued under the following terms & Condition :

1. The results apply to the sample as received only.
2. The sample will be destroyed after retention time unless otherwise specified specially.
3. This report is not to be reproduce wholly or in part and can't be used as evidence in court of law.
4. Abbreviation used (TDS = Total Dissolved Solids, mg/l = milligram per liter, BDL = Below detection limit, APHA = American Public Health Association, IS = Indian Standard, NT = Not Tested, NA = Not Applicable NTU = Nephelometric Turbidity Unit, RA = Reaffirmed, ND=Not Detected, T=Total)
5. * Value not available or test not performed for this parameter.
6. Temperature condition limit: 25±5°C and Humidity condition limit:50 ±20%

Reviewed and Approved By

Principal
AKAL ACADEMY
Raipur PIR BAKSHWALA
Teh. Bhatinda (P.N.)
Mr. Jivesh Kumar
Microbiologist/Analyst
Authorized Signatory
For, District water Testing Laboratory
Kapurthala

----- End of the Test Report -----